



## Analysis & Upgrading Technique of Transmission Towers Due to Wind Zone Reclassification in India

*Arnab Chakraborty<sup>1</sup>, Ashok Kumar Sahoo<sup>2</sup>, Hirdesh Kumar<sup>3</sup>, Mr. Shivam Shekhar<sup>4</sup>*

<sup>1,2,3</sup>UG Student, <sup>4</sup>Guide, Assistant Professor

Department of Civil Engineering, Lingaya's Vidyapeeth, Faridabad

Email : [achakraborty866@gmail.com](mailto:achakraborty866@gmail.com)

DOI : <https://doi.org/10.55248/gengpi.6.0325.1169>

### ABSTRACT:

Enhancing existing transmission towers can often be a smarter, more economical choice compared to building new ones, especially given the hurdles that come with land acquisition. This process involves fortifying the towers to handle increased loads and endure environmental challenges, all while ensuring compliance with the latest building codes to prolong their operational lifespan. The National Building Code of 2016 introduced a revised wind map that has been integrated into the request for proposals (RFP) for transmission projects. To tackle the implications of shifting wind zones on current transmission line towers, it's crucial to strengthen both the towers and their foundations. This undertaking requires a comprehensive design review, careful material selection, and meticulous planning, not to mention scheduled shutdowns, which can significantly tug at the budget and availability. Our current work delves into the analysis and design of a strategy to bolster an existing tower set in wind zone 2, upgrading it to meet the standards of wind zone 4. We have done preemptive strengthening studies using international software (PLS TOWER) and suggested reinforcements of the existing towers in the line which shall support the requirement of higher wind zone. Through our analysis, we discovered that the wind load on the existing tower has surged considerably, resulting in multiple structural members failing under this new pressure. To address this, we've proposed utilizing multiple sub-bracing and a cruciform leg connection to accommodate these heightened loads. Moreover, we've explored the option of performing this work while the line is live, depending on the location of the strengthening efforts. This approach not only helps sidestep right-of-way complications but also ensures that the reliability of the transmission line remains intact.

**KEY WORDS:** Increased Loads, Wind Zones, Right-of-Way, Live Line Work, PLS TOWER

### 1. Introduction

Towers play a critical role in supporting essential infrastructure energy transmission. However, as these structures age and face increasing demands, their ability to maintain performance and safety can be compromised. Over time, factors such as environmental wear, extreme weather conditions, and evolving safety regulations can strain a tower's original design. Strengthening and retrofitting towers is therefore essential to ensure their continued reliability and safety.

The National Building Code of India (NBC), 2016 with updated wind speed maps, replaced the older IS 802: 2015 guidelines, significantly altering how wind loads are assessed for transmission lines. For projects built before 2016, the wind speed criteria may now be outdated in specific locations. These potentially underestimate the risks posed by stronger winds. To address this, it is crucial to reassess local wind conditions and calculate the increased wind loads based on updated wind zones. Reinforcements may need to provide for the existing towers to accommodate higher loads. Some of the upgrades can be possible during service conditions (live line), while others (e.g., cross arms, peak structures) may require shutdowns. This approach ensures the safety and reliability of transmission lines, particularly those built under older standards, in the face of evolving wind conditions.

Tower strengthening helps maintain the structural integrity of these vital assets, reducing the risk of failure and preventing costly replacements. The process of reinforcing towers to comply with updated codes, and extending their operational lifespan, is very challenging. As most of the lines are in operational condition, it is difficult to strengthen the towers without interrupting the service. In this context, understanding the key drivers for tower

reinforcement is crucial for maintaining the safety, functionality, and longevity of these critical structures.

Steel lattice towers are widely used in India and other developing countries for applications such as power transmission. These towers consist of key components like legs, which are vertical steel members that support the structure; bracings, which are diagonal elements that stabilize the tower by distributing loads; cross-arm members, which provide mounting points for equipment like power lines; and secondary members, which offer additional reinforcement. The lattice design is favored for its efficient use of materials, cost-effectiveness, and high load-bearing capacity, making it an ideal choice for such infrastructure. The ideal tower design is one that meets all electrical and structural requirements while using the minimum amount of

steel. In this study, we analyzed the additional loading conditions and identified the most suitable strengthening scheme. However, it is important to note that while there is potential for tower strengthening, the scope for foundation strengthening is limited, and the towers cannot be reinforced beyond a certain threshold.



*Figure 1: Tower failure incident near Bhopal (2019)*



*figure 2: Tower failure due to heavy wind load*

---

## 2. Literature Survey

F. Albermani, M. Mahendran, S. Kitipornchai (2003), found out tower strength improvement by adding a series of diaphragm bracing types at mid-height of the slender diagonal members. Qiang Xie, Li Sun (2012) proposed that sufficient diaphragms should be added in each panel of latticed transmission tower structures in order to enhance the load-carrying capacity and ductility of both the single and double-panel specimens. J.G. Teng a, T. Yu b, D. Fernando (2012) studied strengthening of steel structures with fiber-reinforced polymer composites. External bonding of FRP reinforcement has been clearly established as a promising alternative strengthening technique for steel structures. Chenghao Lu, Xing Ma, Julie E. Mills (2014) studied the structural effect of bolted splices on retrofitted transmission tower angle members. The Experimental tests and numerical results in their study showed that the bolt-splice joint and bolt connector played a critical role in the structural behavior of the bolt spliced reinforced member. Xuewu Liu, Kaiquan Xia, Yan Gao (2011), studied and experimented with the composite section strengthened by the angle-shaped member, such as cross-shaped section, Z-shaped section, T-shaped section, C-shaped section. Julie E. Mills, Xing Ma, Yan Zhuge (2012) showed experimental results verifying the effectiveness of the retrofitting method. Load sharing analysis showed that axial loads can be effectively transferred between original tower members and reinforcing members through the bolted-splice system. As reported by R. Balagopal N. Prasad Rao R. P. Rokade P. K. Umesha (2018), strengthening steel bolted connections in lattice towers with GFRP material is cost-effective, lightweight, and non-corrosive, offering enhanced tension capacity and the ability to operate under live-line conditions. It reduces capital costs by 72% compared to replacing steel structures. Also, it was seen that the cleat angle and double cross-plate connection show higher enhancement of compression strength compared to other types of connections. The cleat angle connection is cost-effective compared to other types of strengthening patterns.

---

## 3. Scope of the Study



In the present scope of work, we have opted for the most economical way to strengthen the tower. A 3D analysis using PLS Tower has been developed. The 3D analysis using PLS Tower is purely a theoretical exercise, this exercise will provide additional safety for the performance of the towers in the higher wind zone areas. PLS-Models of the original designs (WZ-2) have been checked for analysis of towers using the higher loads (WZ-4). All the members which failed have been reinforced with proper reinforcements. Further, the reinforcement members are being connected by the proper methods by means of additional members and plates.

#### 4. Methodology

- Identification of Wind Zone Changes: The revised wind map from the National Building Code 2016 was superimposed onto the old wind map to identify areas where wind zones have been modified. Boxes were used to highlight changes in wind zones, specifically areas shifting from WZ-2 to WZ-4 (Figures 3 & 4).

Figure 3: Old WZ map of India as per IS 802 (Part 1 / Sec 1): 2015 Figure 4: New WZ map of India as per National Building Code (NBC), 2016

IS 802 (Part 1 / Sec 1): 2015

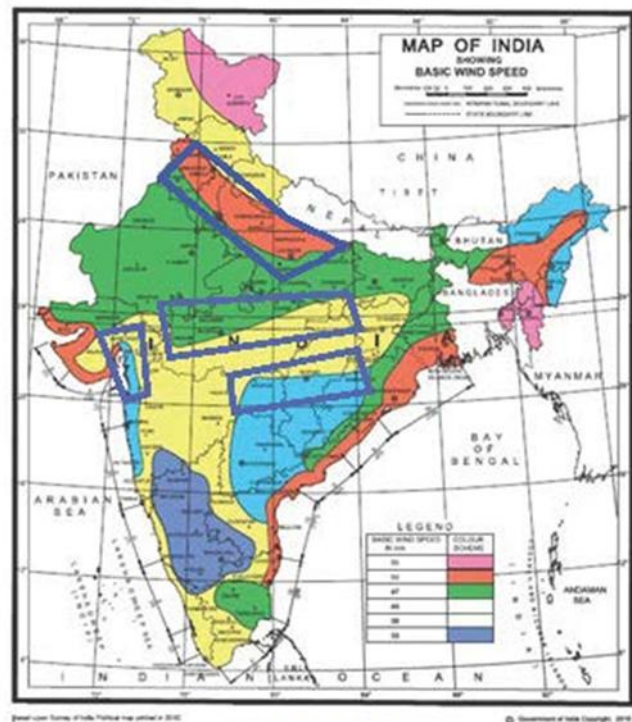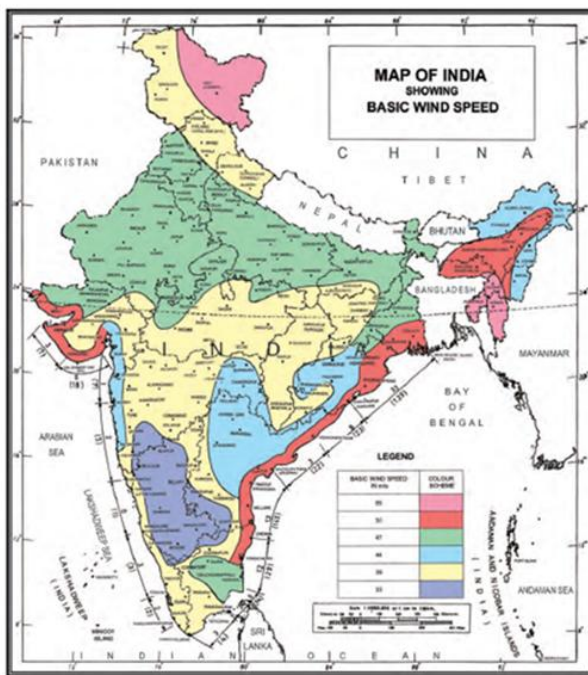

- Wind zones 2 to 4 have been selected for analysis based on the updated map.
- Loading Calculations for WZ-4: Using the IS 802 (Part 1 / Sec 1): 2015 (reaffirmed 2020) standard, wind pressures for WZ-4, other wire load calculations have been done based on the same design spans / weight spans originally used for WZ-2. Loading trees for WZ-4 have been created to be used for running the PLS-models.
- We have worked with D-type tower which have been checked for WZ-4, and the reinforcements have been worked out.
- Development of PLS-Models: The original designs for WZ-2 were analyzed by running PLS-models with the newly calculated higher loads for WZ-4. All structural members that failed under the increased loading conditions were identified and highlighted in RED for reinforcement.
- Reinforcement Design: Structural drawings were referenced to determine the most practical approach for implementing reinforcements. Key reinforcements included:
  - Star leg connections to reinforce failing corner legs with suitable joints and stitch plates.
  - Additional redundant members (such as lattices, cross arm members, belt members, and peak members) were added to improve the overall load-carrying capacity of the tower components.

#### 5. General Considerations:

**Modeling Approach:** For the present study, 765 kV single circuit tension transmission line tower has been considered. PLS Tower software is used for the analysis and design of steel latticed towers. The program performs design checks of structures under user specified loads. For electric power structures it can also calculate maximum allowable wind and weight spans and interaction diagrams between different ratios of allowable wind and weight spans.

- All dimensions are in mm and loads are in Kg
- Load and Loading combinations criteria on the ground wire, conductor and all the towers are found using IS: 802 (Part-1/Sec-1): 2015.
- The designs conform to the relevant requirements of Technical Specification and IS: 802 (Part-1/Sec-1): 2015. For design of compression members, the strut formulae given in IS-802(Part-1) 2015 are adopted.
- Mild Steel conforming to IS-2062, 2006 or equivalent ( $F_y = 250 \text{ N/mm}^2 = 2549 \text{ kg/cm}^2$ )
- High Tensile Steel conforming to IS-2062, 2006 or equivalent ( $F_y = 350 \text{ N/mm}^2 = 3569 \text{ kg/cm}^2$ )
- Bolts & Nuts as per IS: 12427-2001 Grade 5.6/5.0 or equivalent are considered and 16mm Dia Bolts are considered in tower design.

Table 1: Configuration of Tower

Description	Square Tower
Base Width at +0m BE	17706 mm
Hamper (Cage) Width	4800 mm
Topmost Hamper (Peak) Width	3200 mm
Height of Tower	47375 mm

Table 2: Line Characteristics

Phase Configuration	Vertical
Ground Clearance	18 m
Sag Error	150 mm
C.L. to G.L.	225 mm
Mid Span Clearance	9 m
Angle of Shield	10 Deg.
Final Unloaded Tension for conductor at Everyday Temperature	Not to exceed 22% of UTS
Final unloaded Tension for Earth-wire/OPGW at Everyday Temp.	Not to exceed 20% of UTS
Earth wire Sag	90% of conductor sag
Wind Zone	4
Reliability Level	2
Terrain Category	2

Table 3: Electrical Characteristics

Nominal Voltage	765 kV
Maximum System Voltage	800kV
Rated Frequency	50 Hz
System Neutral Earthing	Effectively earthed
BIL (Impulse)	2400 kV (Peak)
Switching Surge Withstand Voltage	1550kV (rms)
Power Frequency Withstand Voltage	830kV (rms)

Corona Extinction Voltage At 50 Hz, Under Dry Condition	510kV (rms) min
RIV Voltage at One MHz for Phase to Earth Voltage Of 305 kV Under Dry Condition	1000 Micro volts (max)
Short Circuit Current and Duration	50 kA for one second

Table 4: Climatic Condition

Temperature For Creep Calculation	32 Deg
Maximum Ambient Temperature	50 Deg
Everyday Temperature	32 Deg
Minimum Temperature	0 Deg
Maximum Temperature Conductor	85 Deg
Maximum Temperature Shield Wire	53 Deg

Table 5: Conductor Properties

Size/Code	ACSR Bersimis
Number Of Conductors Per Phase	4
Conductor Spacing	457 mm
Approximately Diameter	35.05 mm
UTS	154 KN
inear mass of the Conductor	2181 Kg/Km
Cross Sectional Area	725 mm <sup>2</sup>
Modulus of Elasticity	6322 Kg/mm <sup>2</sup>
Coefficient of Linear Expansion	0.000012 Deg C

Table 6: Earth wire Properties

Number Of Earth Wire/OPGW	One GSS wire & one OPGW
Earth Wire Size	7/3.66mm
Approximate Diameter GSS	10.98mm
Approximate Mass GSS	583 Kg/Km
UTS	68.4KN
Coefficient of Linear Expansion	11.5 X e-06
Cross sectional Area	73.65 mm <sup>2</sup>
Modulus of Elasticity	19361 Kg/mm <sup>2</sup>

Table 7: OPGW properties

Overall Diameter	12.00mm
UTS	92.9 KN
Approximate Mass	455 ± 10%kg/km
Cross sectional Area	73.5 mm <sup>2</sup>
Modulus of elasticity	140KN/mm <sup>2</sup>

**6. Design Analysis:****Wind Pressure Calculation as per WZ-4**

		<u>FOR TOWER</u> <u>TYPE-SD</u>	
<b><u>WIND PRESSURE CALCULATIONS</u></b>			
<b><u>(Clause 8.3, IS 802 (Part 1 / Sec 1): 2015)</u></b>			
Wind Zone to be considered for design	=	4	47.00 M/sec
Design wind speed (Vr)	=	47/1.375	
	=	34.182	M/sec
Basic span	=	400	M
Reliability Level	=	2	
Terrain Category	=	2	
Factor K1	=	1.12	
Factor K2	=	1	
Design wind speed (Vd)	=	Vr x K1 x K2	
	=	34.182 x 1.12 x 1	
	=	38.284	M/sec
Design wind pressure (Pd)	=	0.6 x (Vd) <sup>2</sup>	
Design Wind Pressure (Pd)	=	(0.6 x 38.284 <sup>2</sup> )	
	=	879.399	N/m <sup>2</sup>
	=	<b>89.643</b>	<b>Kg / m<sup>2</sup></b>
 <b><u>(I) Wind Pressure on Conductor (Pc) = Pd x Cd x Gc</u></b>			
Average Height of conductor considered for wind pressure calculation (h)			<b>44.315</b> M
Sag at Min temp and nil wind (m) =		11.141	
Minimum ground clearance		14.500	
Spacing between conductor		0.229	
Maximum Sag of conductor		14.864	
Allowance for sag error or creep		0.150	
B.C.A to T.C.A.		13.000	
Body extension		9.000	

Less 2/3rd Sag at Min temp.	$2/3 \times 11.141$	7.427		
Avg. height of Conductor in M		<b>44.315</b>		
Where	Pd = Design Wind Pressure			
	Cd = Drag Coefficient	1		
	Gc = Gust Response Factor =	2.237		
(Refer Table -7 of IS 802-1995/Sec-1)				
	=	$89.643 \times 1 \times 2.237$		
<b>Wind Pr. on Conductor (Pc)</b>	=	<b>200.53</b>	<b>Kg/m<sup>2</sup></b>	<b>Say 201 Kg/sqm</b>

				<b><u>FOR TOWER</u></b>
				<b><u>TYPE-SD</u></b>
<b><u>(II) Wind Pressure on Earthwire (Pe) = Pd x Cd x Gc</u></b>				
Average Height of earthwire considered for wind pressure calculation (h)		<b>51.292</b>		<b>M</b>
Sag at Min temp and nil wind (m) =		7.426		
Minimum ground clearance		14.500		
Spacing between conductor		0.229		
Maximum Sag of conductor		14.864		
Allowance for sag error or creep		0.150		
B.C.A to T.C.A cross arm		13.000		
Height of G.W peak		4.500		
Maximum body extension		9.000		
Less 2/3rd Sag at Min temp.	$2/3 \times 7.426$	-4.951		
Average height of Ground wire in M		<b>51.292</b>		
Where	Pd = Design Wind Pressure			
	Cd = Drag Coefficient	1.2		for earth wire
	Gc = Gust Response Factor =	2.296		
(Refer Table -7 of IS 802-1995/Sec-1)				
Wind Pressure on Earth wire (Pe)	=	$89.643 \times 1.2 \times 2.296$		

**Wind Pressure on Earth wire (Pe) = 246.98 Kg/m<sup>2</sup> Say 247 Kg/sqm**

**(III) Wind Pressure on Insulator (Pi) = Pd x Cd x Gc**

Height of insulator attachment point considered for wind pressure (h) 51.742 M

Minimum ground clearance 14.500

Spacing between conductor 0.229

Maximum Sag of conductor 14.864

Allowance for sag error or creep 0.150

B.C.A to T.C.A cross arm 13.000

Maximum length of insulator 0.000

Maximum body extension 9.000

Maximum leg extension 0

Height of Insulator attachment point in M 51.742

Where Pd = Design Wind Pressure

Cd = Drag Coefficient 1.2 for Insulator

Gc = Gust Response Factor = 2.492

(Refer Table - 6 of IS 802-1995/Sec-1)

Wind Pressure on Insulator (PI) = 89.643 x 1.2 x 2.492

**Wind Pressure on Insulator (PI) = 268.07 Kg/m<sup>2</sup> Say 269 Kg/sqm**

## 7. Results

Table 8: Wind Load Comparission WZ-2 Vs WZ-4



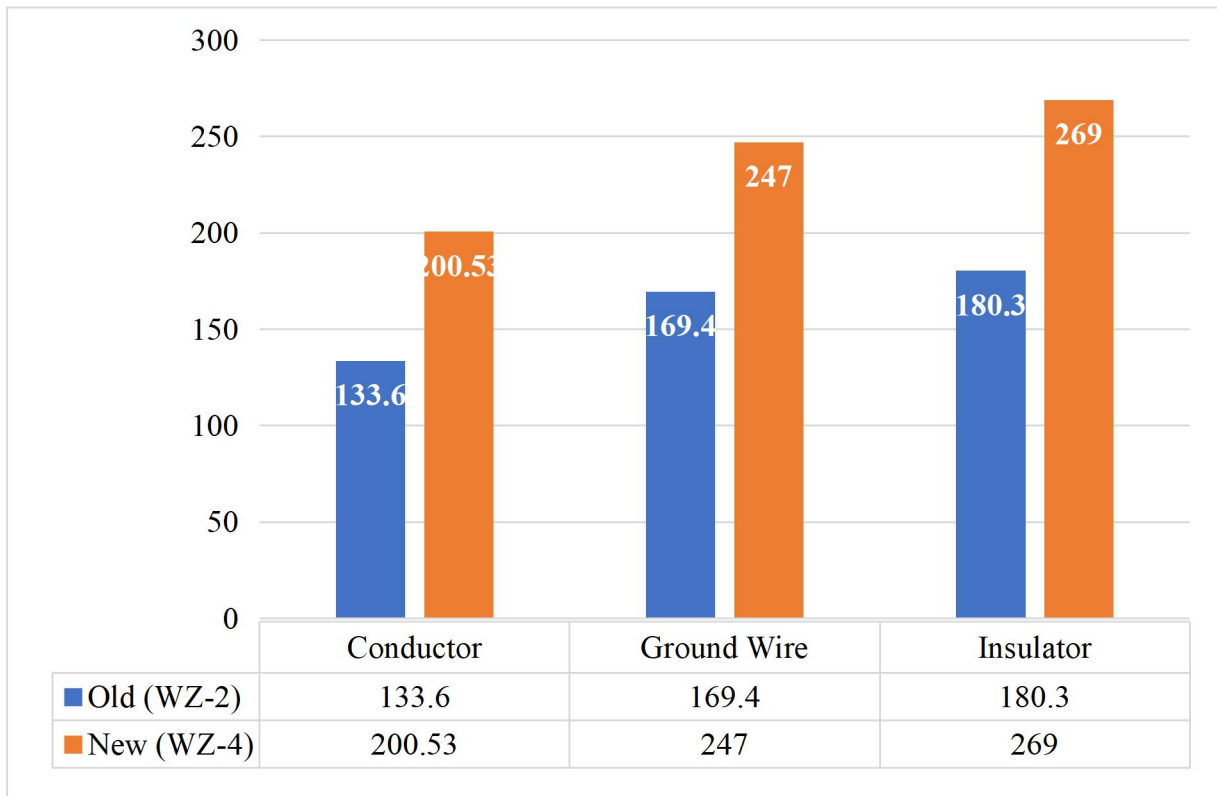


Table 9: Comparison b/w WZ-2 Vs 4 Load Case

C-1 Reliability Condition (32 Deg & Full Wind)



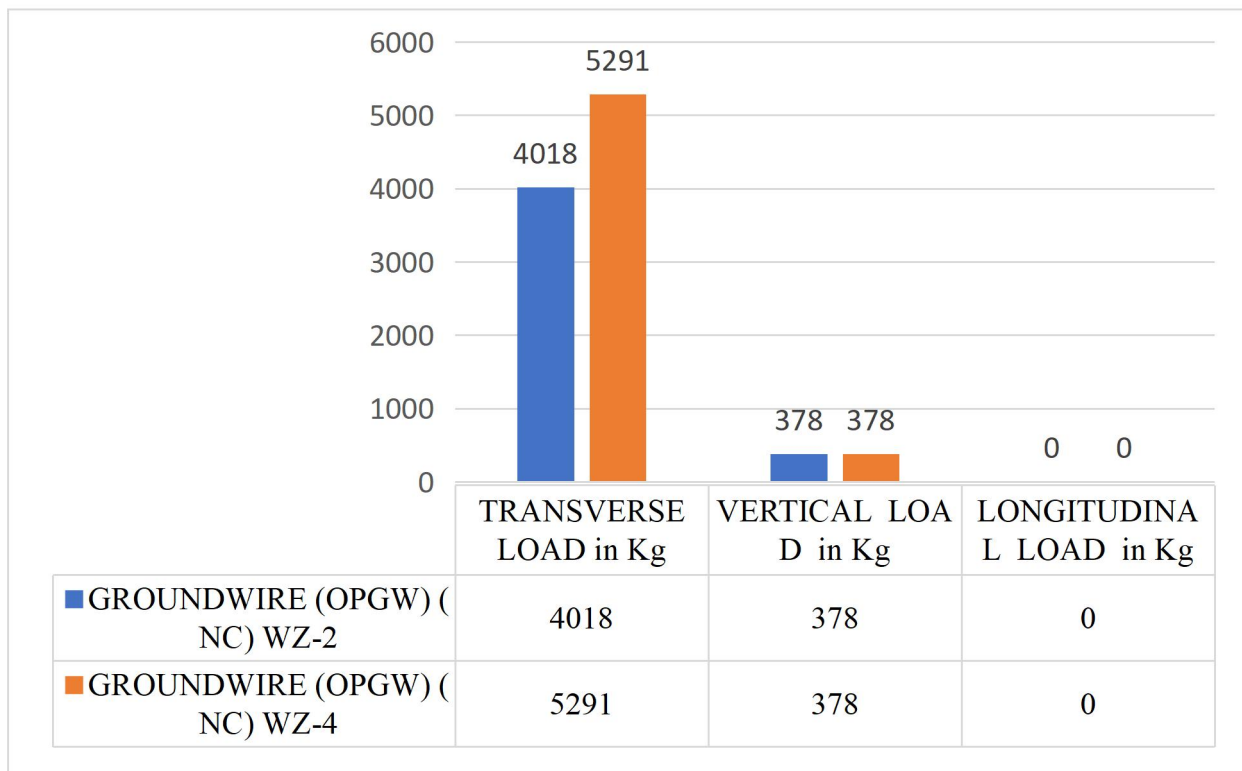


Table 10: Foundation Loads Comparison b/w WZ-2 Vs 4


Compression Force WZ-2 Vs WZ-4,

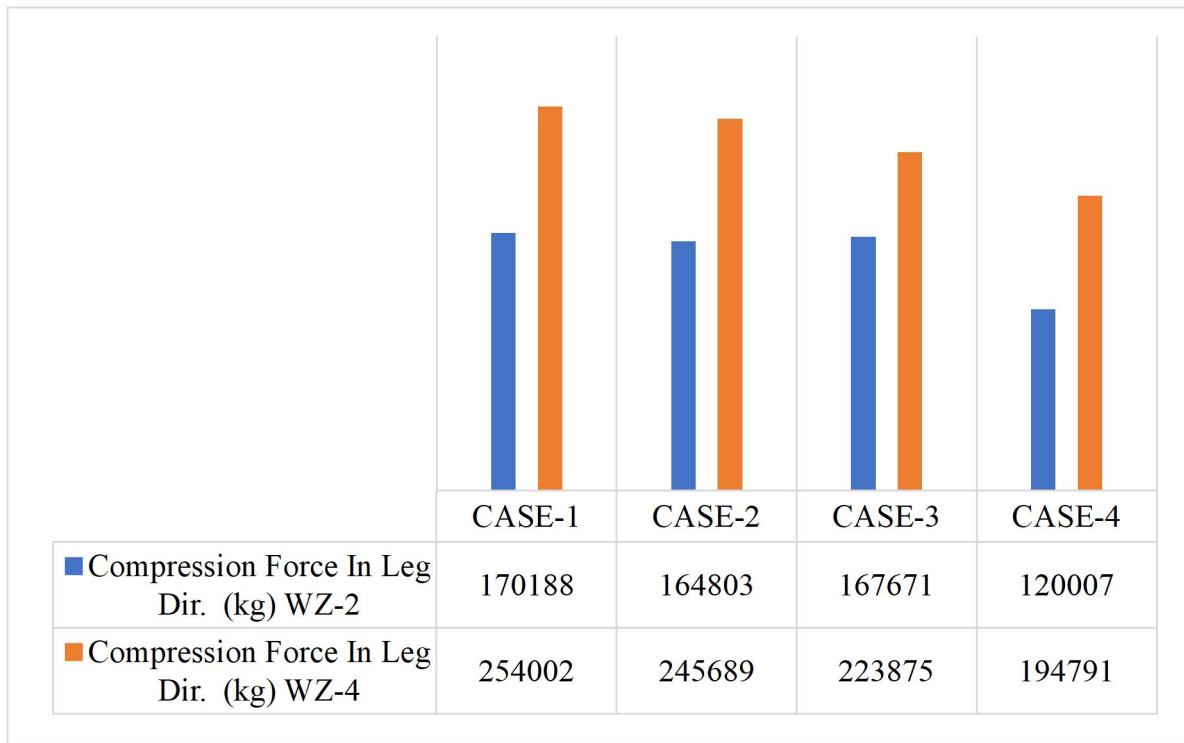

Uplift Force WZ-2 Vs WZ-4,

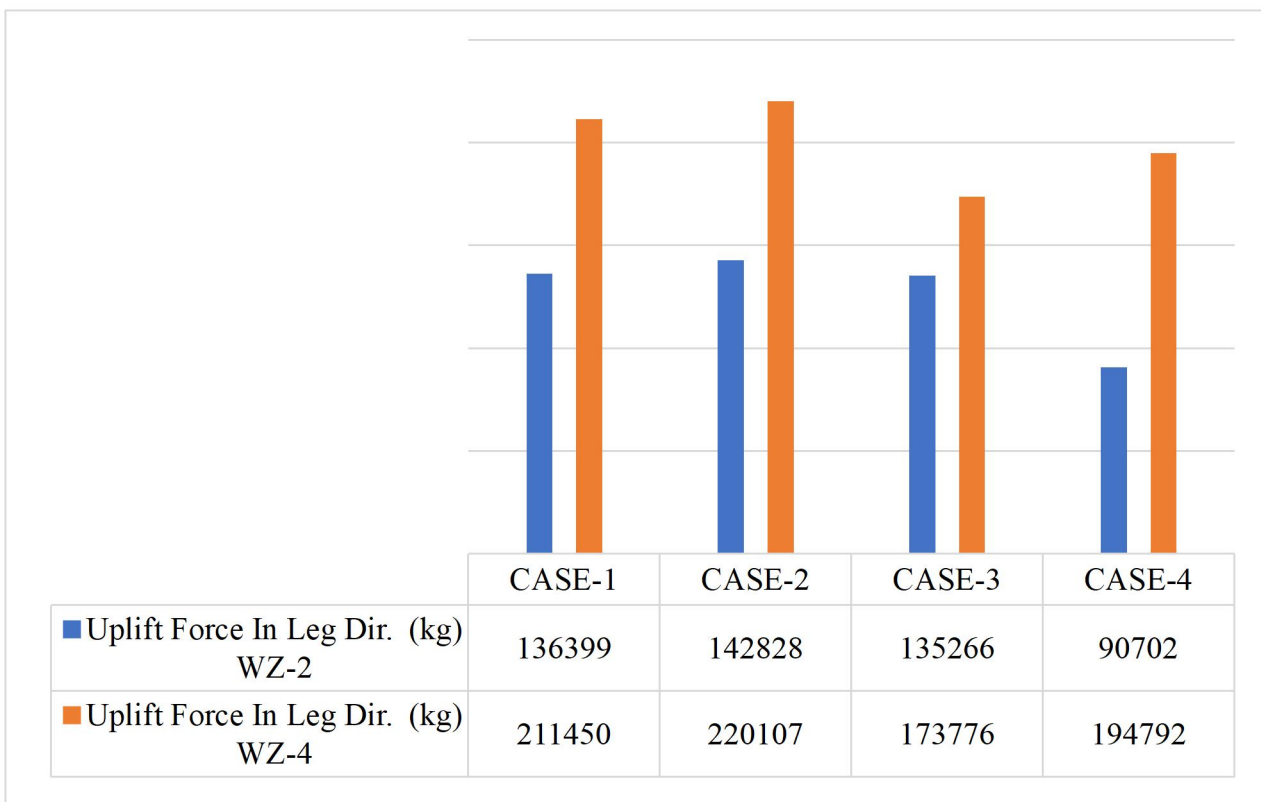

Transverse Shear WZ-2 Vs WZ-4,

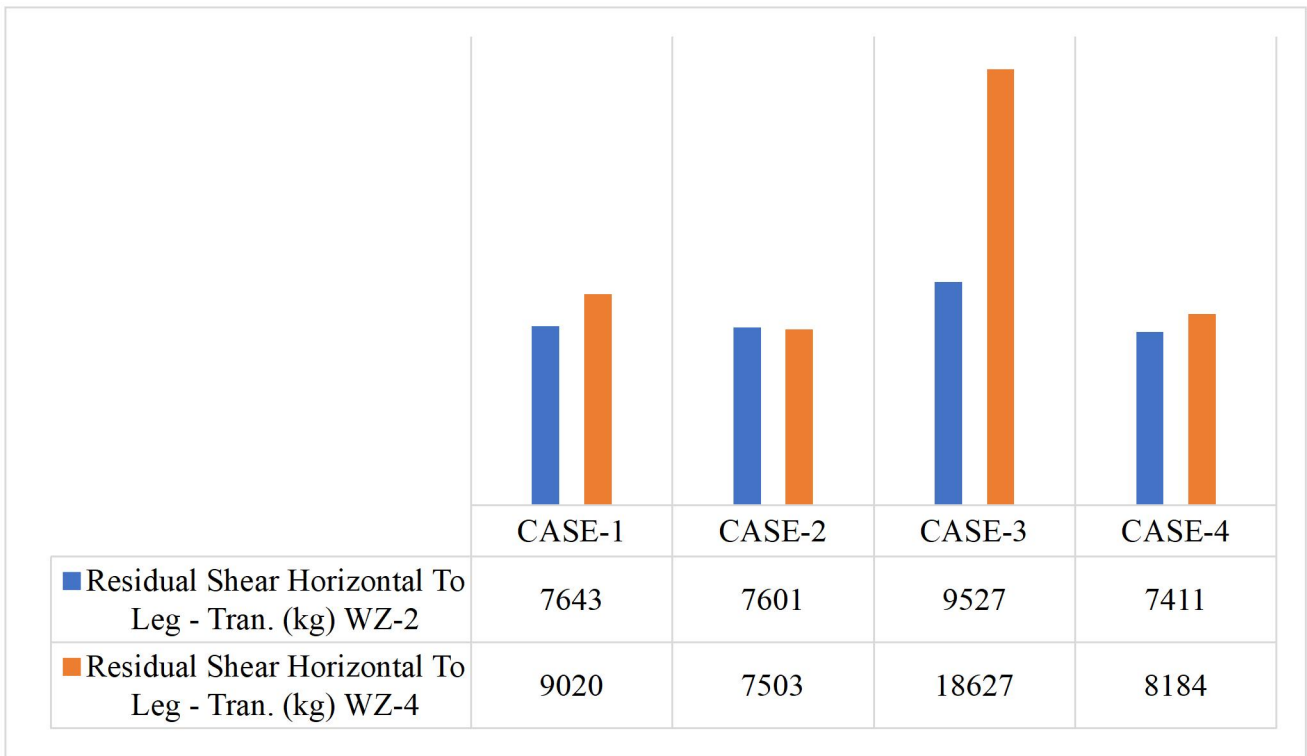

Longitudinal Shear WZ-2 Vs WZ-4,


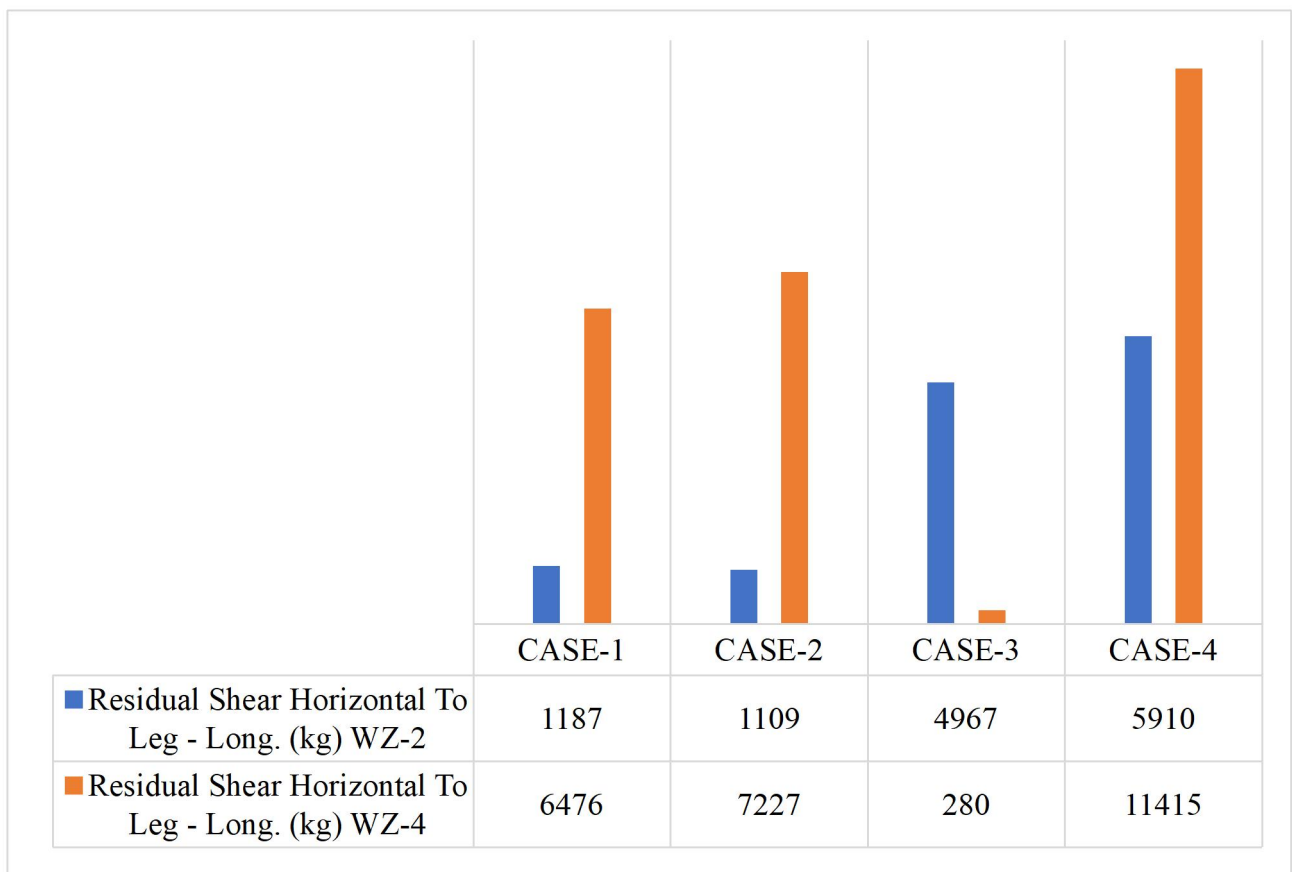


Table 11: Design Summary Comparission


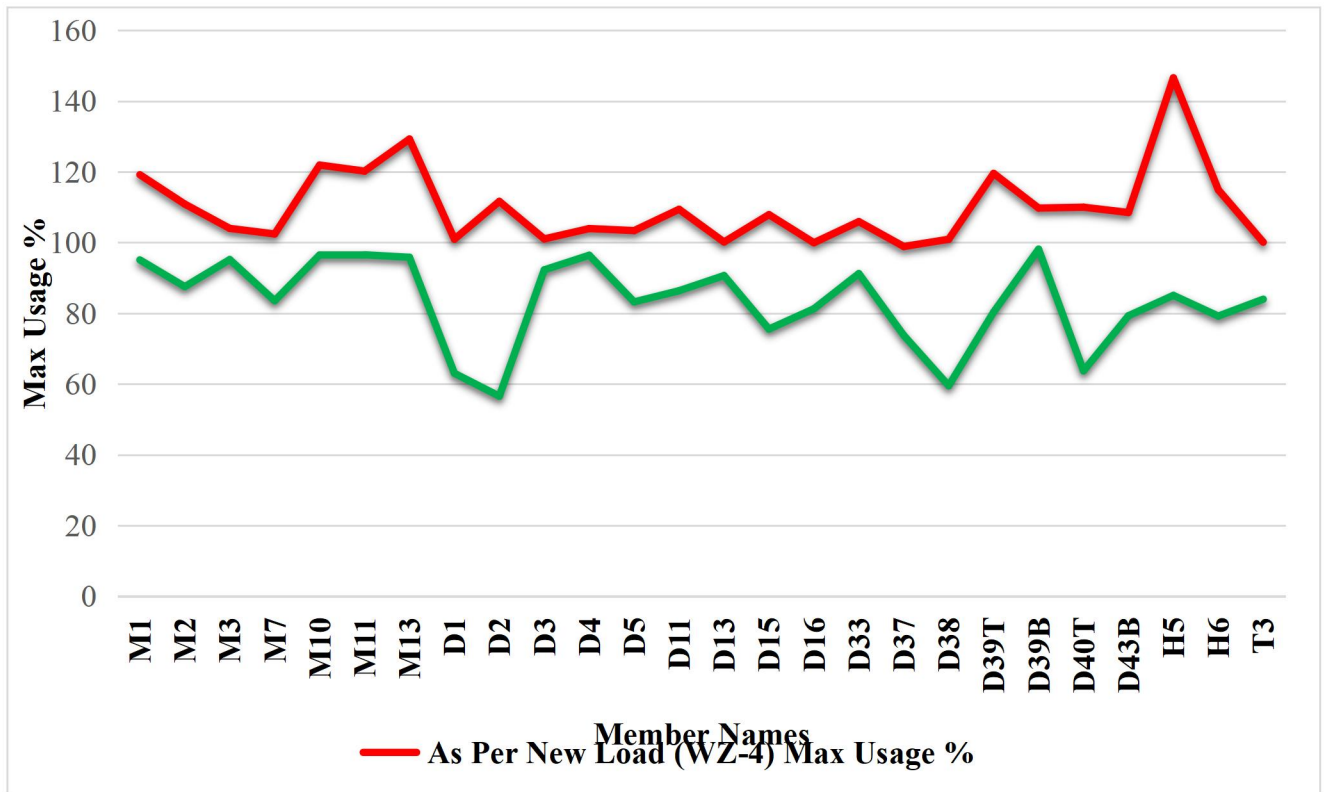


### 8. Strengthening Scheme

- Additional redundant members to be provided to improve the overall load-carrying capacity of the tower components.

EXISTING PATTERN FOR WZ-2

REVISED PATTERN FOR WZ-4

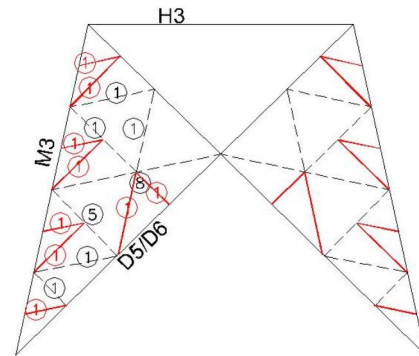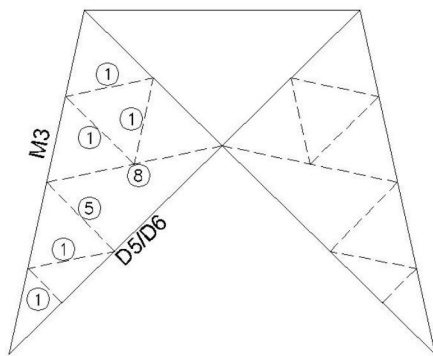

STANDARD TOWER MEMBERS

Figure 5: Revised Structural Drawings

- Star leg connections to reinforce failing legs

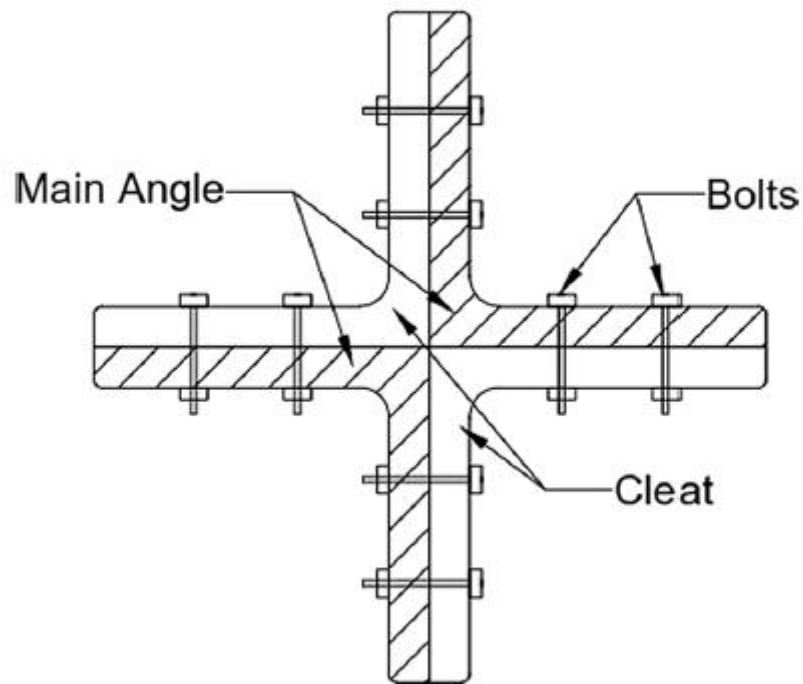


Figure 6: Leg Connection Details

## 9. References

- IS:802—Part 1 Section 1. (2015). Use of structural steel in overhead transmission line towers—Code of practice part 1 materials, loads and design strengths section 1 materials and loads. Bureau of Indian Standards.
- Manual on Transmission Line PB-323, Central Board of Irrigation & Power
- National Building Code (NBC), 2016
- F. Albermani, M. Mahendran, S. Kitipornchai. Upgrading of transmission towers using a diaphragm bracing system
- Qiang Xie, Li Sun Failure mechanism and retrofitting strategy of transmission tower structures under ice load
- J.G. Teng, T. Yu, D. Fernando Strengthening of steel structures with fiber-reinforced polymer composites
- Chenghao Lu, [Xing Ma](#), Julie E. Mills The structural effect of bolted splices on retrofitted transmission tower angle members
- Xue Wu Liu, Kai Quan Xia, Yan Gao Experimental Study on Strengthening the Structure of Tower of Overhead Transmission Line
- Yan Zhuge, Julie E. Mills, [Xing Ma](#) Modelling of steel lattice tower angle legs reinforced for increased load capacity
- R. Balagopal, N. Prasad Rao, R. P. Rokade & P. K. Umesha. Experimental Investigation on Strengthening of Bolted Connections in Transmission/Communication Towers